

HS-422I/M Intrinsically Safe Accelerometer




4-20mA acceleration output via PUR Cable

Key Features

- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Waterproof and resistant to oil

Industries

Building services, Pulp and Paper, Mining, Metals, Utilities, Automotive, Water, Pharmaceutical

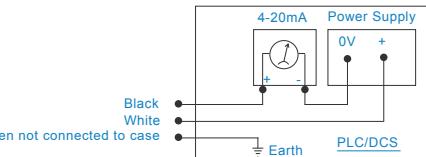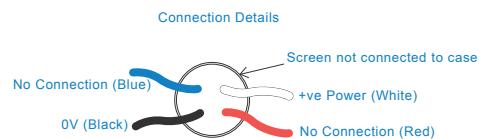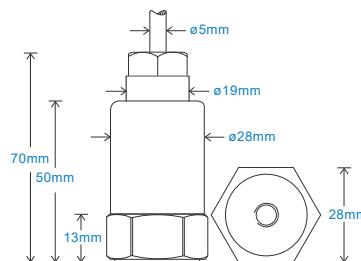

Technical Performance

Mounted Base Resonance	10kHz min
Acceleration Ranges	see: 'How To Order' table $\pm 10\%$ Nominal 80Hz at 22°C
Frequency Response	10Hz (600cpm) to 5kHz (300kcpm) $\pm 5\%$ - ISO10816
Isolation Range	Base isolated see: 'How To Order' table
Transverse Sensitivity	Less than 5%

Mechanical

Case Material	Stainless Steel
Sensing Element/Construction	PZT/Compression
Mounting Torque	8Nm
Weight	150gms (nominal)
Maximum Cable Length	1000 metres
Standard Cable Length	5 metres
Screened Cable	PUR - length to be specified with order
Mounting Threads	see: 'How To Order' table
Submersible Depth	100 metres max. (10 bar)


Electrical

Current Output	4-20mA DC proportional to acceleration
Supply Voltage	15-30 Volts DC (for 4-20mA)
Settling Time	2 seconds
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts
Case Isolation	$>10^8$ Ohms at 500 Volts

Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP68
Maximum Shock	5000g
EMC	EN61326-1:2013

Typical Frequency Response

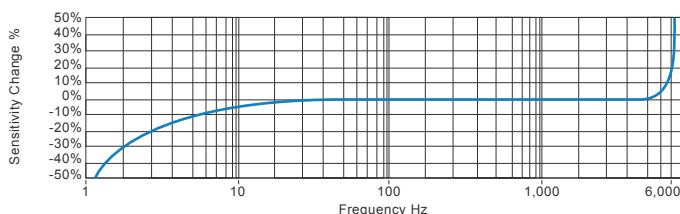

Applications

Fans, Motors, Pumps, Compressors, Centrifuges, Conveyors, Air Handlers, Gearboxes, Rolls, Dryers, Presses, Cooling, VAC, Spindles, Machine Tooling, Process Equipment

Vibration sensor should be firmly fixed to a flat surface (spot face surface may be needed to be produced and cable anchored to sensor body.)



Certifications



This product is certified in accordance with
UL 913, 8th Ed. Rev. December 6, 2013
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice
TS435.13




HS-422I/M Intrinsically Safe Accelerometer

4-20mA acceleration output via PUR Cable

Intrinsically Safe Requirements

Maximum Cable Length	nominal 100 metres see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231
Certificate details: Group I + II	IECEx BAS08.0034X Baseefa08ATEX0086X	Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C Zone 20, AEx, ia, IIIC, T130°C, IP65, Da, -40°C to +110°C	
	Ex ia IIC T6 Ga Ex ia IIIC T80°C IP65 Da Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	② II 1GD ② I M1 ② I Ma	Barrier 1 x Pepperl + Fuchs Galvanic Isolator KFD2-STC4-Ex1, which has superseded KFD2-CR-Ex1.30300 (BAS00ATEX7164) see attached system drawings
Certificate details: Group II	Ex ia IIC T4 Ga Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)	② II 1GD	1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217) or Pepperl + Fuchs Zener Barrier Z787 (BAS01ATEX7005) or any other barrier that conforms to system drawings attached
Accelerometer System Certificate	Baseefa08Y0087 Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Zener Barrier	see attached system drawings
Terminal Parameters	Ui = 28V, Ii = 115mA, Pi = 0.65W Group II Ui = 16.5V Pi = 0.65W or Ui = 28V Ii = 115mA Pi = 0.65W Group I	System Connections for Galvanic Isolator	see attached system drawings
500V Isolation	Units Will Pass A 500V Isolation Test	Terminal Parameters	Ui = Vmax = 28V Ii = Imax = 115mA Pi = 0.65W
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust) Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)	Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
Australia Approval Group 1	IECEx ITA 10.0003X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)		
South African Approval	Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

How To Order

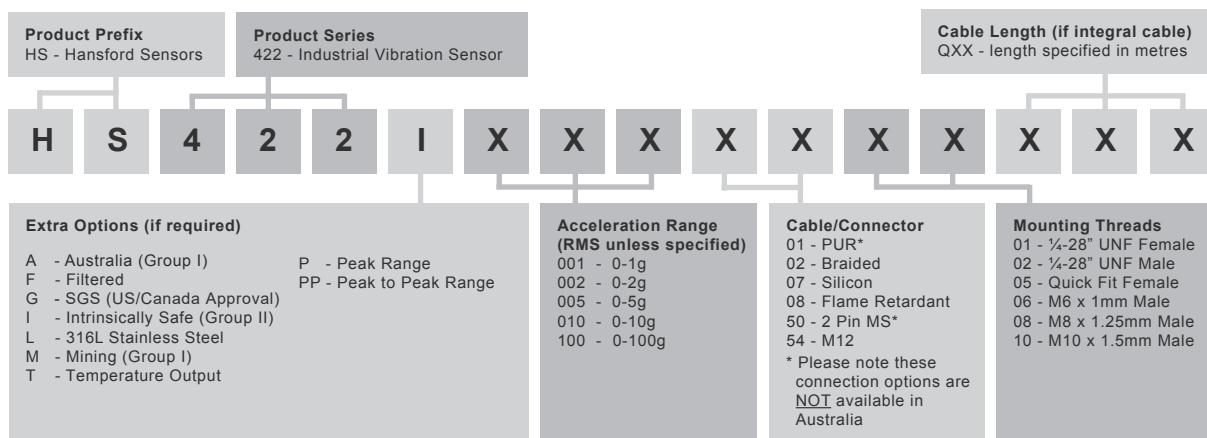

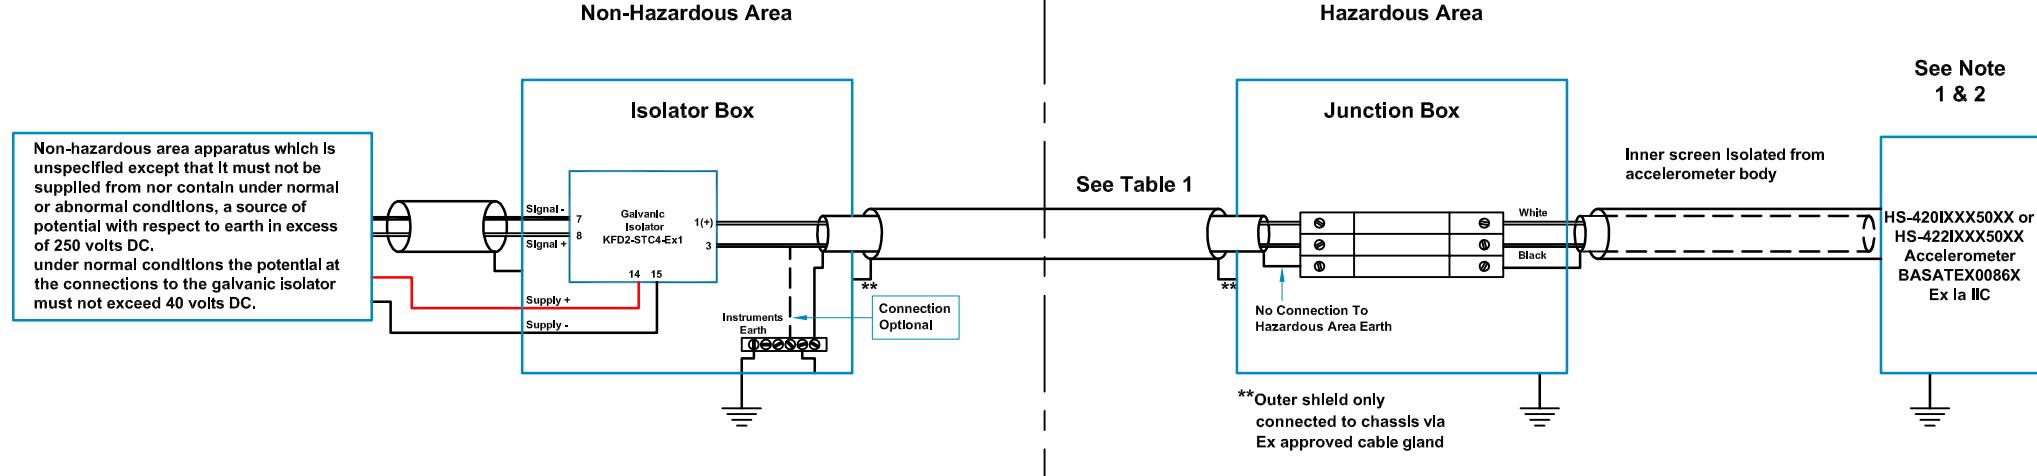


Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length \leq 10m

Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.097	72
IIB	0.768	277
IIA	2.598	585

Accelerometer With Integral Cable Length \leq 50m

Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.091	72
IIB	0.762	277
IIA	2.592	585

Accelerometer With Integral Cable Length \leq 100m

Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.083	72
IIB	0.754	277
IIA	2.584	585

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System

Ex ia IIC T6 (-40°C \leq Ta \leq +60°C)

Notes:

1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
3. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A	Hansford Sensors Excellence in Vibration Monitoring	All Dimensions In mm Unless Otherwise Stated	Description: System Connections Details	
A	Release	16/09/15	MJS	CMH	For HS-420I & HS-422I Group II Accelerometers With PUR Cable F.U.W. Galvanic Isolation			Drawing No: M06-061-A	
					Tolerances Unless Stated 0 or 0.0 \pm 0.5 0.00 \pm 0.15 Angle \pm 5°	Finish All Over Threads g6 H6		Do Not Scale	Scale: NTS
									Form Number: QF024 Issue 1
									Sheet: 1 of 1
1	2	3	4	5	6	7	8		

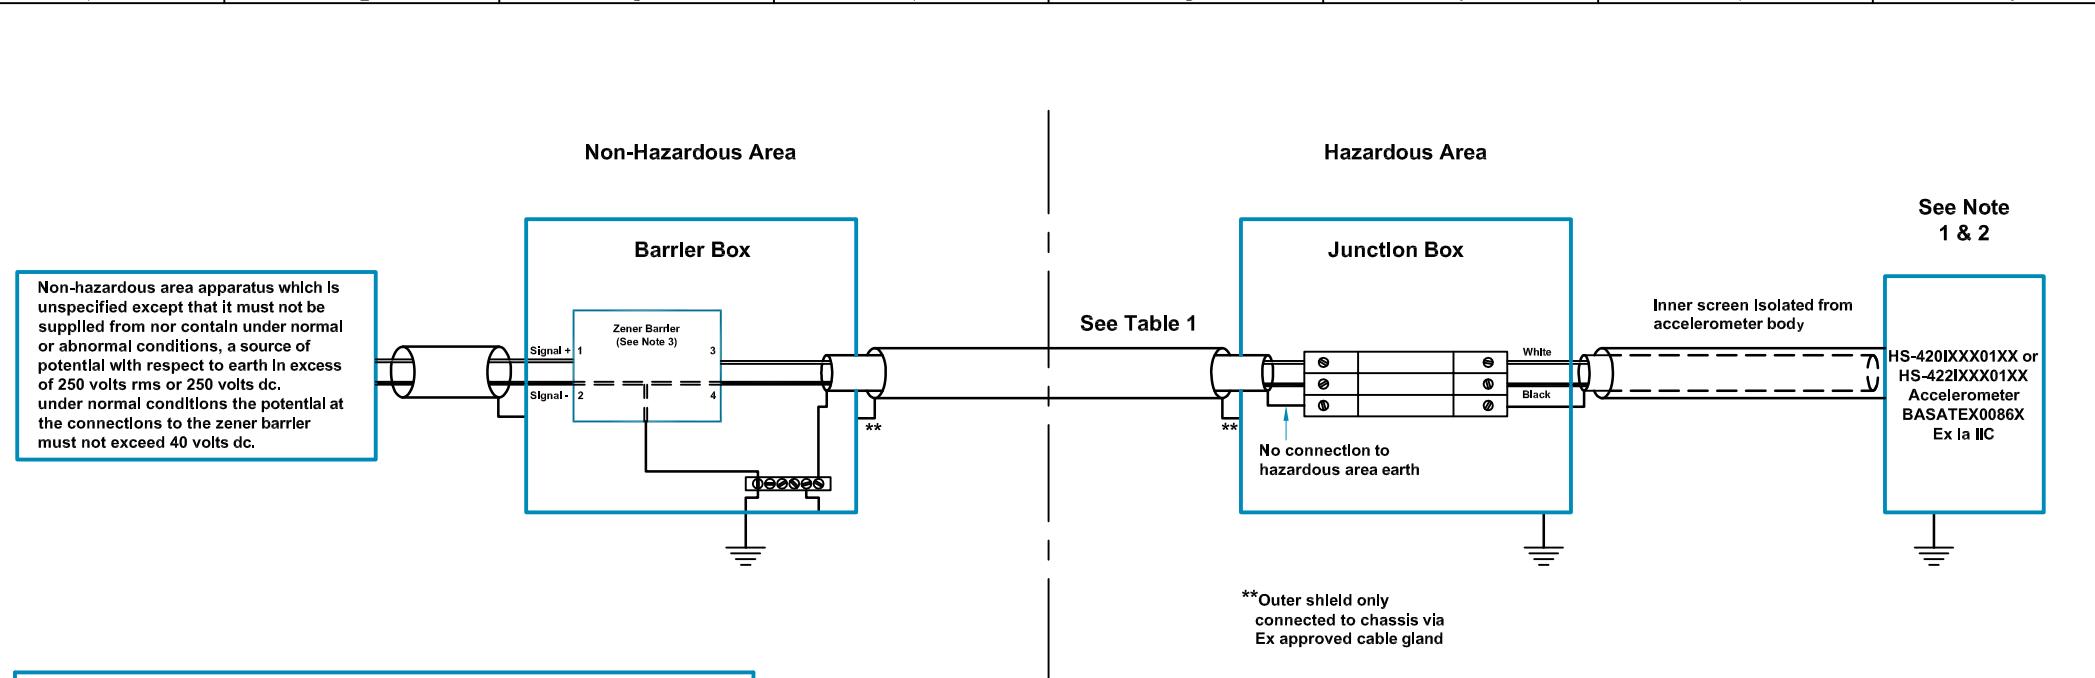


Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length \leq 10m

Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.081	56
IIB	0.247	168
IIA	0.662	448

Accelerometer With Integral Cable Length \leq 50m

Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.075	56
IIB	0.241	168
IIA	0.656	448

Accelerometer With Integral Cable Length \leq 100m

Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.067	56
IIB	0.233	168
IIA	0.648	448

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System

Ex ia IIC T6 (-40°C \leq Ta \leq +60°C)

Notes:

1. The capacitance and Inductance, or Inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
3. Any shunt zener diode safety barrier certified by an ec approved body to [EEx ia] IIC having the following output parameters: Uo = 28V dc, Io = 93mA dc, Po = 0.65W. e.g. MTL7787 to BAS01ATEX7217 or Pepperl + Fuchs Z787 to BAS01ATEX7005.
4. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A	Do Not Scale	Description: System Connections For HS-420I & HS-422I Group II Accelerometers With PUR Cable F.U.W. Zener Barrier
A	Release	16/09/15	MJS	CMH	Tolerances Unless Stated 0 or 0.0 \pm 0.5 0.00 \pm 0.15 Angle \pm 5°	Finish All Over Threads g6 H6	 Hansford Sensors Excellence in Vibration Monitoring
							All Dimensions In mm Unless Otherwise Stated
							If In Doubt - Ask!
							Drawing No: M06-061-A
							Scale: NTS
							Form Number: QF024 Issue 1
							Sheet: 2 of 2
1	2	3	4	5	6	7	8

HS-422I/M Intrinsically Safe Accelerometer


4-20mA acceleration output via 2 Pin MS Connector

Key Features

- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Customisable features

Industries

Building services, Pulp and Paper, Mining, Metals, Utilities, Automotive, Water, Pharmaceutical

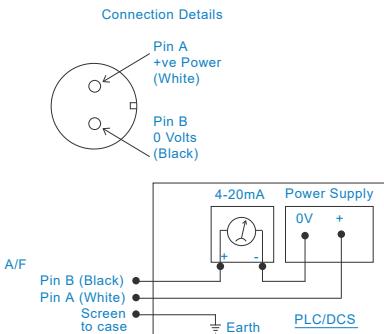

Technical Performance

Mounted Base Resonance	10kHz min
Acceleration Ranges	see: 'How To Order' table ±10% Nominal 80Hz at 22°C
Frequency Response	10Hz (600cpm) to 5kHz (300kcpm) ± 5% - ISO10816
Isolation Range	Base isolated 50g peak
Transverse Sensitivity	Less than 5%

Mechanical

Case Material	Stainless Steel
Sensing Element/Construction	PZT/Compression
Mounting Torque	8Nm
Weight	150gms (nominal)
Screened Cable Assembly	see: www.hansfordsensors.com for options
Connector	HS-AA004 - non-booted
Mounting Threads	see: 'How To Order' table


Electrical

Current Output	4-20mA DC proportional to acceleration
Supply Voltage	15-30 Volts DC (for 4-20mA)
Settling Time	2 seconds
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts
Case Isolation	>10 ⁸ Ohms at 500 Volts

Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP68
Maximum Shock	5000g
EMC	EN61326-1:2013


Typical Frequency Response

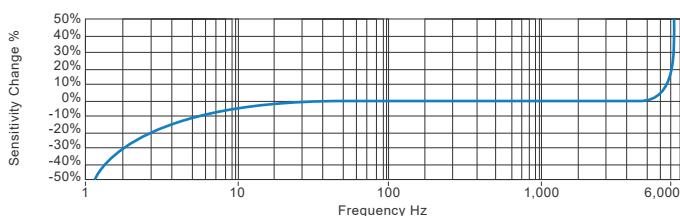

Applications

Fans, Motors, Pumps, Compressors, Centrifuges, Conveyors, Air Handlers, Gearboxes, Rolls, Dryers, Presses, Cooling, VAC, Spindles, Machine Tooling, Process Equipment

Vibration sensor should be firmly fixed to a flat surface (spot face surface may be needed to be produced and cable anchored to sensor body.)



Certifications



This product is certified in accordance with
UL 913, 8th Ed. Rev. December 6, 2013
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice
TS392.14




HS-422I/M Intrinsically Safe Accelerometer

4-20mA acceleration output via 2 Pin MS Connector

Intrinsically Safe Requirements

Maximum Cable Length	See website: www.hansfordsensors.com see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231 Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C Zone 20, AEx, ia, IIIC, T130°C, IP65, Da, -40°C to +110°C
Certificate details: Group I + II	IECEx BAS08.0034X Baseefa08ATEX0086X Ex ia IIC T6 Ga Ex ia IIIC T80°C IP65 Da Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	② II 1GD ② I M1 ② II 1GD Ex ia IIC T4 Ga Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)	Barrier 1 x Pepperl + Fuchs Galvanic Isolator KFD2-STC4-Ex1, which has superseded KFD2-CR-Ex1.30300 (BAS00ATEX7164) see attached system drawings
Certificate details: Group II	Ex ia IIIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C)	Ex ia IIC T4 Ga Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)	1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217) or Pepperl + Fuchs Zener Barrier Z787 (BAS01ATEX7005) or any other barrier that conforms to system drawings attached
Accelerometer System Certificate	Baseefa08Y0087 Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Zener Barrier	see attached system drawings
Terminal Parameters	Ui = 28V, Ii = 115mA, Pi = 0.65W Group II Ui = 16.5V Pi = 0.65W or Ui = 28V Ii = 115mA Pi = 0.65W Group I	System Connections for Galvanic Isolator	see attached system drawings
500V Isolation	Units Will Pass A 500V Isolation Test	Terminal Parameters	Ui = Vmax = 28V Ii = Imax = 115mA Pi = 0.65W
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust) Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)	Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
Australia Approval Group 1	IECEx ITA 10.0003X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)		
South African Approval	Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

How To Order

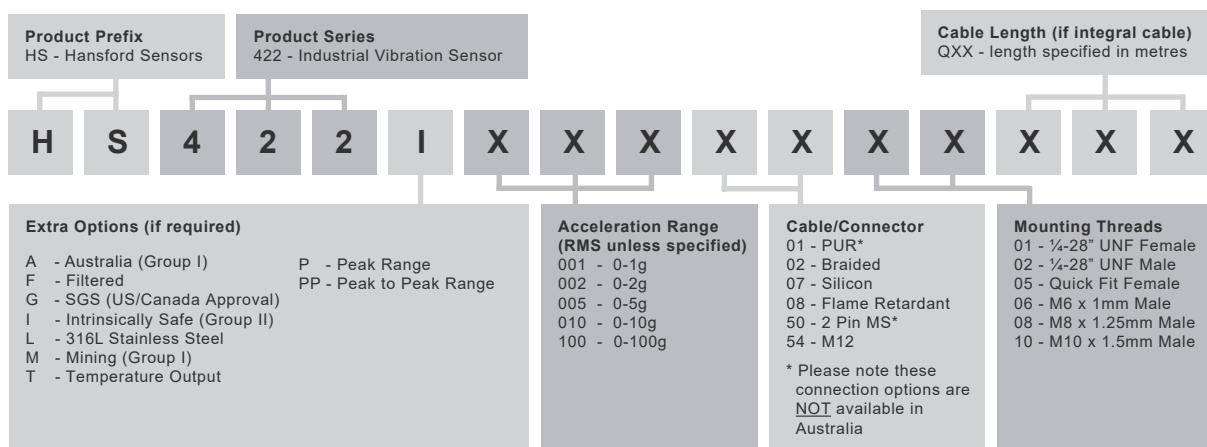

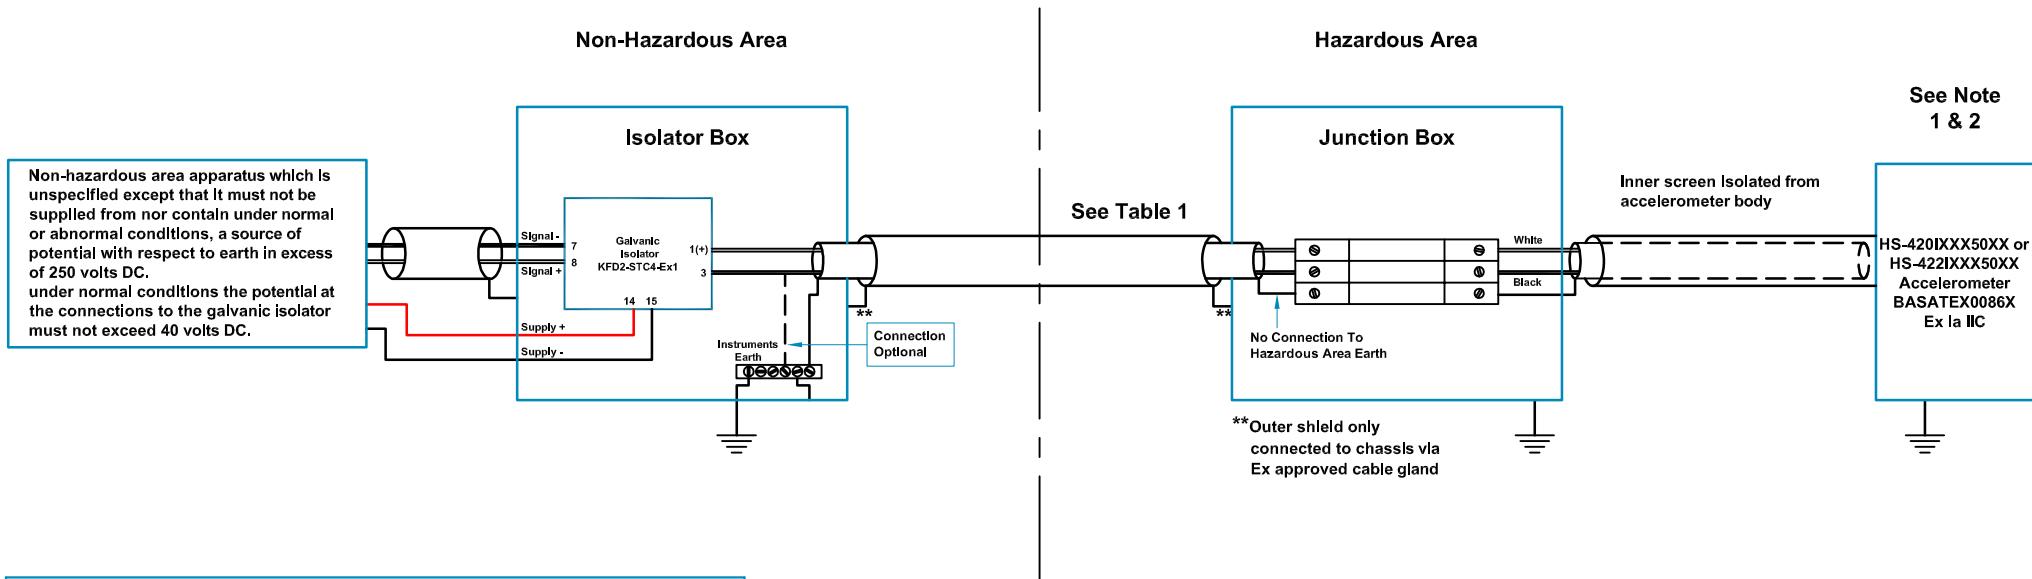


Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length ≤ 10m		
Group	Capacitance μF	L/R Ratio $\mu\text{H}/\Omega$
IIC	0.097	72
IIB	0.768	277
IIA	2.598	585
Accelerometer With Integral Cable Length ≤ 50m		
Group	Capacitance μF	L/R Ratio $\mu\text{H}/\Omega$
IIC	0.091	72
IIB	0.762	277
IIA	2.592	585
Accelerometer With Integral Cable Length ≤ 100m		
Group	Capacitance μF	L/R Ratio $\mu\text{H}/\Omega$
IIC	0.083	72
IIB	0.754	277
IIA	2.584	585

Hansford Sensors Ltd

HS-420I & HS-422I Accelerometer System

Notes:

1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
3. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A	 Hansford Sensors <small>Excellence in Vibration Monitoring</small>		Do Not Scale	Description: System Connections Details For HS-420I & HS-422I Group II Accelerometers With 2 Pin MS Connector F.U.W. Galvanic Isolation		
A	Release	16/09/15	MJS	CMH	Tolerances Unless Stated				All Dimensions In mm Unless Otherwise Stated		
					0 or 0.0 ± 0.5 0.00 ± 0.15 Angle $\pm 5^\circ$	1.6/ Finish All Over Threads g6 H6			Drawing No: M06-059-A		
									If In Doubt - Ask!	Scale: NTS	Form Number: QF024 Issue 1
										Sheet: 1 of 1	
1	2	3	4	5	6	7	8				

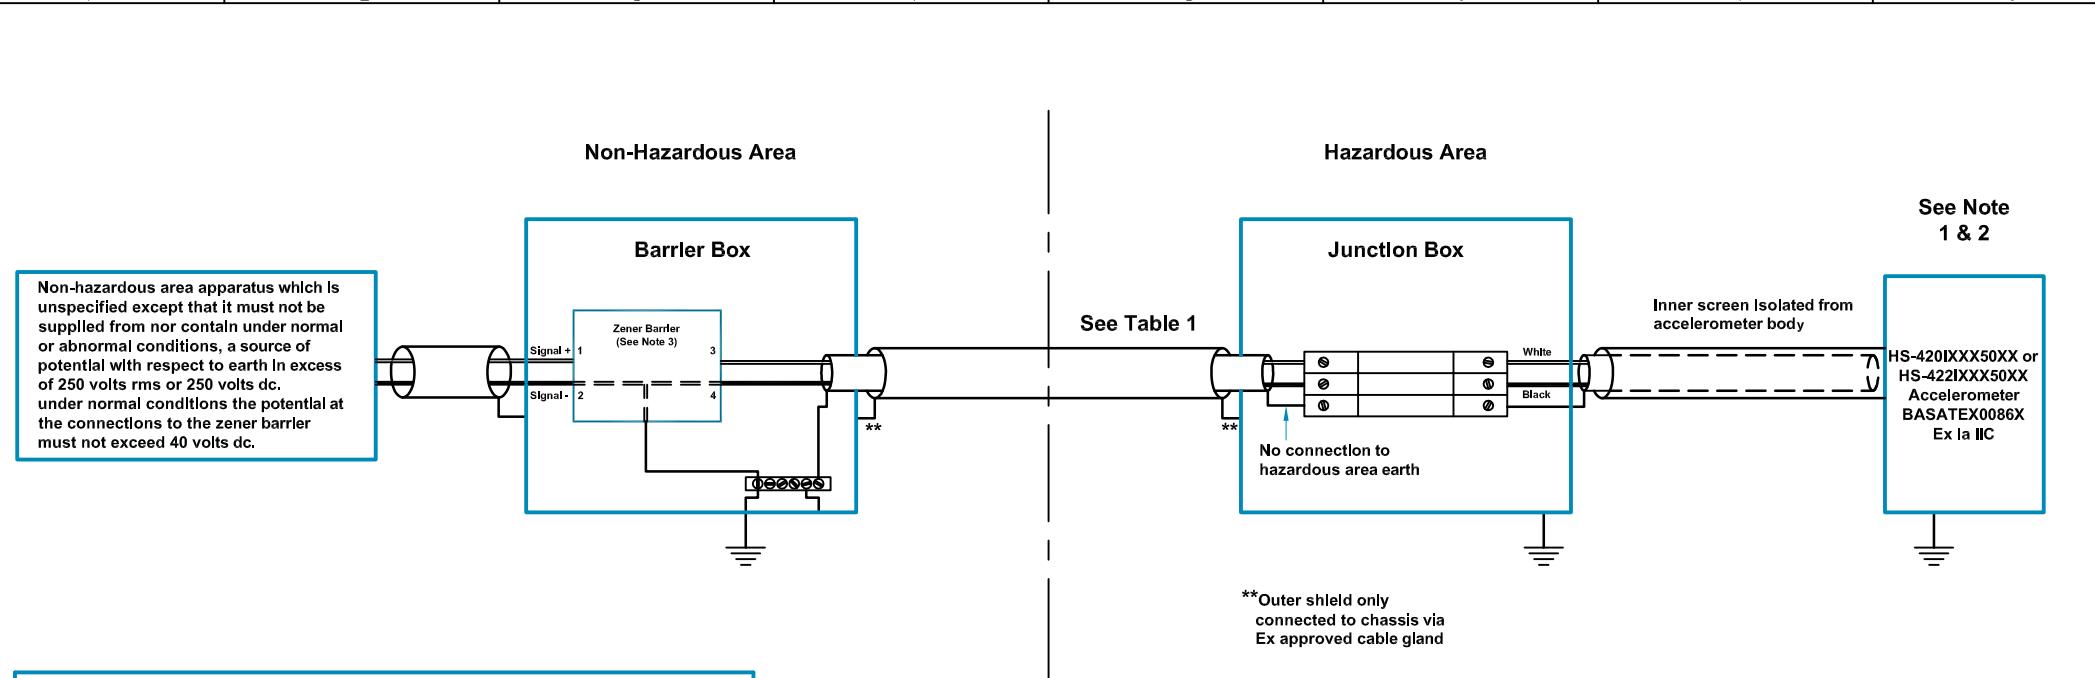


Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length \leq 10m

Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.081	56
IIB	0.247	168
IIA	0.662	448

Accelerometer With Integral Cable Length \leq 50m

Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.075	56
IIB	0.241	168
IIA	0.656	448

Accelerometer With Integral Cable Length \leq 100m

Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.067	56
IIB	0.233	168
IIA	0.648	448

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System

Ex ia IIC T6 (-40°C \leq Ta \leq +60°C)

Notes:

1. The capacitance and Inductance, or Inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
3. Any shunt zener diode safety barrier certified by an ec approved body to [EEx ia] IIC having the following output parameters: Uo = 28V dc, Io = 93mA dc, Po = 0.65W. e.g. MTL7787 to BAS01ATEX7217 or Pepperl + Fuchs Z787 to BAS01ATEX7005.
4. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A	Tolerances Unless Stated 0 or 0.0 \pm 0.5 0.00 \pm 0.15 Angle \pm 5°	Hansford Sensors Ltd Artisan, Hillbottom Rd Sands Industrial Estate High Wycombe Bucks. HP12 4HJ	Do Not Scale	Description: System Connections For HS-420I & HS-422I Group II Accelerometers With 2 Pin MS Connector F.U.W. Zener Barrier		
F	A	Release	16/09/15	MJS	CMH				If In Doubt - Ask!	Drawing No: M06-059-A	Scale: NTS
										Sheet: 2 of 2	Form Number: QF024 Issue 1
1	2	3	4	5	6	7	8				

HS-422I/M Intrinsically Safe Accelerometer



4-20mA acceleration output via Braided Cable

Key Features

- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Customisable features

Industries

Building services, Pulp and Paper, Mining, Metals, Utilities, Automotive, Water, Pharmaceutical

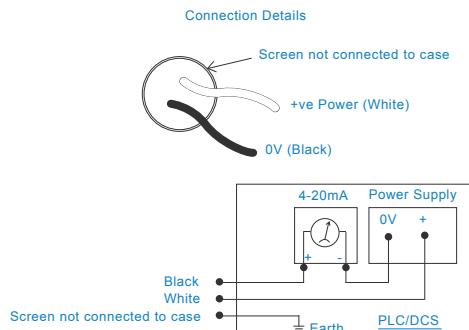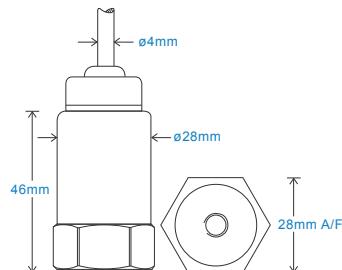


Technical Performance

		Technical Performance	Mechanical	
Mounted Base Resonance		10kHz min	Case Material	Stainless Steel
Acceleration Ranges	see: 'How To Order' table	±10%	Sensing Element/Construction	PZT/Compression
		Nominal 80Hz at 22°C	Mounting Torque	8Nm
Frequency Response	10Hz (600cpm) to 5kHz (300kcpm)	± 5% - ISO10816	Weight	150gms (nominal)
Isolation	Base isolated		Maximum Cable Length	1000 metres
Range	50g peak		Standard Cable Length	5 metres
Transverse Sensitivity	Less than 5%		Mounting Threads	Braided - length to be specified with order see: 'How To Order' table

Electrical

Current Output	4-20mA DC proportional to acceleration	Operating Temperature Range	see: attached certification details
Supply Voltage	15-30 Volts DC (for 4-20mA)	Sealing	IP65
Settling Time	2 seconds	Maximum Shock	5000g
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts	EMC	EN61326-1:2013
Case Isolation	>10 ⁸ Ohms at 500 Volts		

Typical Frequency Response

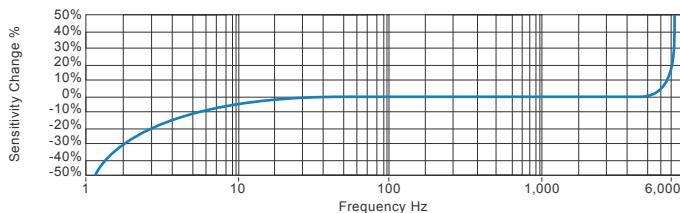

Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP65
Maximum Shock	5000g
EMC	EN61326-1:2013

Applications

Fans, Motors, Pumps, Compressors, Centrifuges, Conveyors, Air Handlers, Gearboxes, Rolls, Dryers, Presses, Cooling, VAC, Spindles, Machine Tooling, Process Equipment

Vibration sensor should be firmly fixed to a flat surface (spot face surface may be needed to be produced and cable anchored to sensor body.)



Certifications



This product is certified in accordance with
UL 913, 8th Ed. Rev. December 6, 2013
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice
TS065.21




HS-422I/M Intrinsically Safe Accelerometer

4-20mA acceleration output via Braided Cable

Intrinsically Safe Requirements

Maximum Cable Length	nominal 100 metres see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231
Certificate details: Group I + II	IECEx BAS08.0034X Baseefa08ATEX0086X	Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C Zone 20, AEx, ia, IIIC, T130°C, IP65, Da, -40°C to +110°C	
	Ex ia IIC T6 Ga Ex ia IIIC T80°C IP65 Da Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	② II 1GD ② I M1 ② I Ma	Barrier 1 x Pepperl + Fuchs Galvanic Isolator KFD2-STC4-Ex1, which has superseded KFD2-CR-Ex1.30300 (BAS00ATEX7164) see attached system drawings
Certificate details: Group II	Ex ia IIC T4 Ga Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)	② II 1GD	1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217) or Pepperl + Fuchs Zener Barrier Z787 (BAS01ATEX7005) or any other barrier that conforms to system drawings attached
Accelerometer System Certificate	Baseefa08Y0087 Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Zener Barrier	see attached system drawings
Terminal Parameters	Ui = 28V, Ii = 115mA, Pi = 0.65W Group II Ui = 16.5V Pi = 0.65W or Ui = 28V Ii = 115mA Pi = 0.65W Group I	System Connections for Galvanic Isolator	see attached system drawings
500V Isolation	Units Will Pass A 500V Isolation Test	Terminal Parameters	Ui = Vmax = 28V Ii = Imax = 115mA Pi = 0.65W
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust) Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)	Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
Australia Approval Group 1	IECEx ITA 10.0003X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)		
South African Approval	Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

How To Order

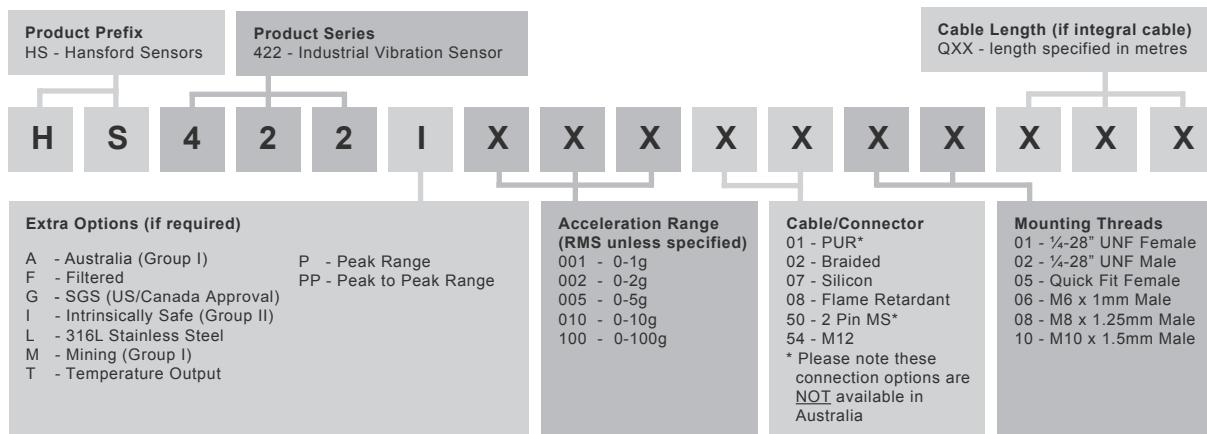

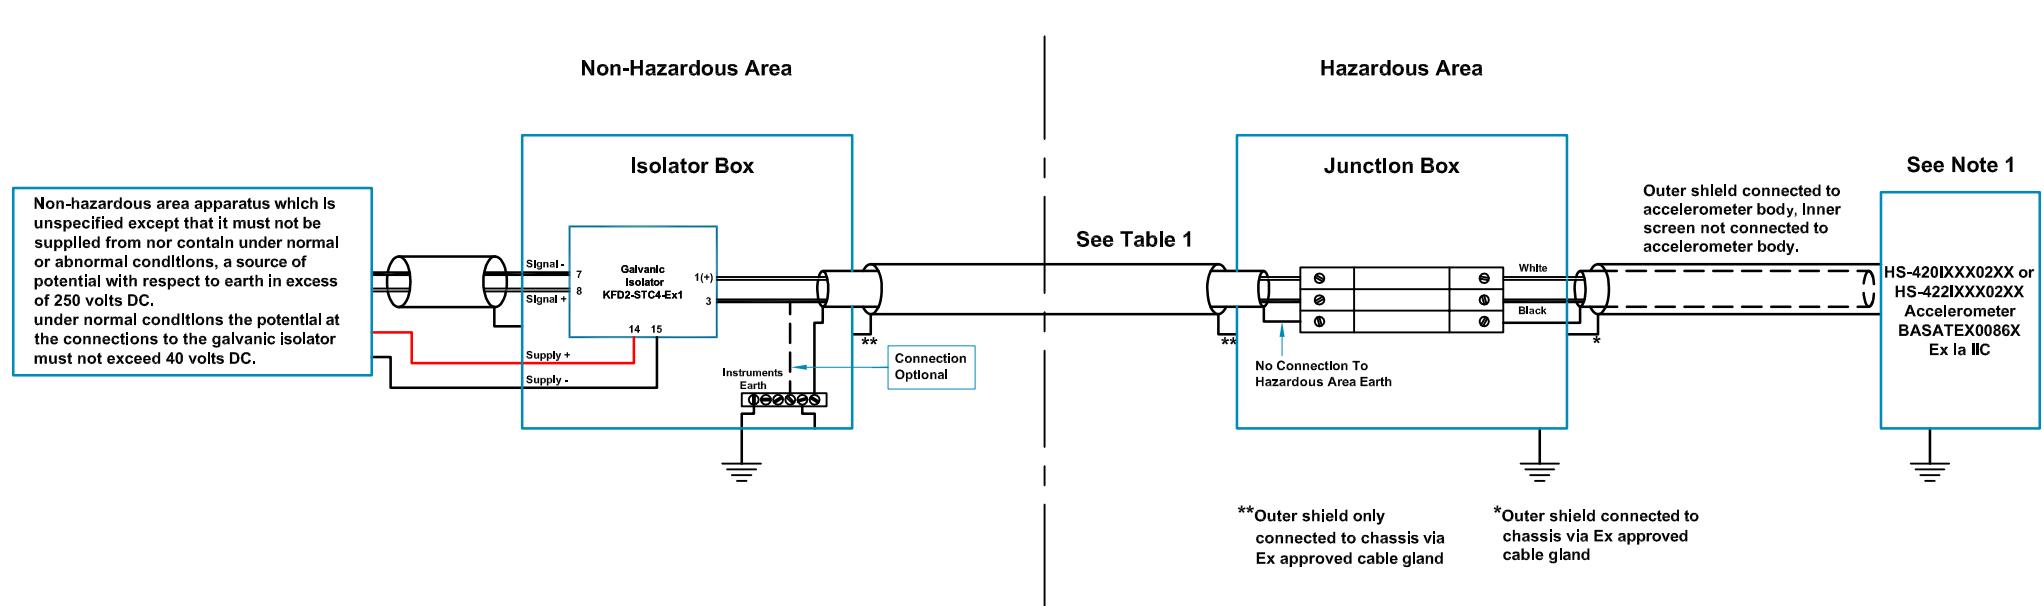


Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length \leq 10m		
Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.096	72
IIB	0.767	277
IIA	2.597	585
Accelerometer With Integral Cable Length \leq 50m		
Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.084	72
IIB	0.755	277
IIA	2.585	585
Accelerometer With Integral Cable Length \leq 100m		
Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.070	72
IIB	0.741	277
IIA	2.571	585

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer SystemEx ia IIC T6 (-40°C \leq Ta \leq +60°C)


Notes:

1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in table 1.
2. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.


Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A	Tolerances Unless Stated 0 or 0.0 \pm 0.5 0.00 \pm 0.15 Angle \pm 5°	Hansford Sensors Excellence in Vibration Monitoring Hansford Sensors Ltd Saunderton Business Park Haw Lane Saunderton Bucks HP14 4JE	Do Not Scale	Description: System Connections For HS-420I & HS-422I Group II Accelerometers With Armoured Cable F.U.W. Galvanic Isolation		
A	Release	17/06/10	MJS	CMH					All Dimensions In mm Unless Otherwise Stated		
									If In Doubt - Ask!		
									Scale: NTS	Form Number: QF024 Issue 1	
									Sheet: 1 of 2		

Non-hazardous area apparatus which is unspecified except that it must not be supplied from nor contain under normal or abnormal conditions, a source of potential with respect to earth in excess of 250 volts rms or 250 volts dc. under normal conditions the potential at the connections to the zener barrier must not exceed 40 volts dc.

Non-Hazardous Area

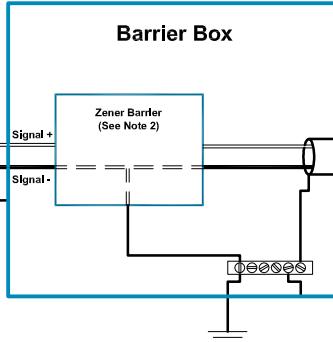

Hazardous Area

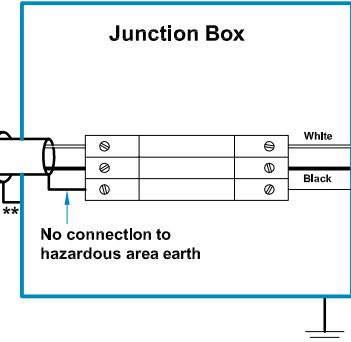

See Note 1

HS-420XXX02XX or
HS-422XXX02XX
Accelerometer
BASATEX0086X
Ex ia IIC

Outer shield connected to
accelerometer body, Inner
screen not connected to
accelerometer body.

**Outer shield only
connected to chassis via
Ex approved cable gland

*Outer shield connected to
chassis via Ex approved
cable gland

baseefa 08

0 0 8 7



Baseefa
Certification
Schedule
Drawing

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System
Baseefa08Y0087
Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

Notes:

1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. Any shunt zener diode safety barrier certified by an EC approved body to [Ex ia] IIC having the following output parameters: Uo = 28V dc, Io = 93mA dc, Po = 0.65W, e.g. MTL7787+ to BAS01ATEX7217 or Pepperl + Fuchs Z787 to BAS01ATEX7005
3. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length ≤ 10m

Group	Capacitance μF	L/R Ratio $\mu\text{H}/\Omega$
IIC	0.080	56
IIB	0.246	168
IIA	0.661	448

Accelerometer With Integral Cable Length ≤ 50m

Group	Capacitance μF	L/R Ratio $\mu\text{H}/\Omega$
IIC	0.068	56
IIB	0.234	168
IIA	0.649	448

Accelerometer With Integral Cable Length ≤ 100m

Group	Capacitance μF	L/R Ratio $\mu\text{H}/\Omega$
IIC	0.054	56
IIB	0.220	168
IIA	0.635	448

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A
A	Release	10/03/08	MJS	CMH	

Tolerances Unless Stated
0 or 0.0 ± 0.5
0.00 ± 0.15
Angle $\pm 5^\circ$

$^{1.6}$ Finish All Over
Threads g6 H6

Hansford Sensors
Excellence in Vibration Monitoring

Hansford Sensors Ltd
Saunderton Business Park
Haw Lane
Saunderton
Bucks HP14 4JE



Do Not Scale

All Dimensions In mm Unless
Otherwise Stated

If In Doubt - Ask!

Description: System Connections
For HS-420I & HS-422I Group II
Accelerometers With Armoured Cable
F.U.W. Zener Barrier

Drawing No: M06-011-A

Scale: NTS

Form Number:

Sheet: 2 of 2

QF024 Issue 1

HS-422I/M Intrinsically Safe Accelerometer


4-20mA acceleration output via Flame Retardant Cable

Key Features


- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Low smoke, halogen free cable

Industries

Building services, Pulp and Paper, Mining, Metals, Utilities, Automotive, Water, Pharmaceutical

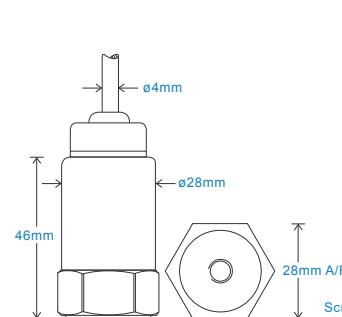

Connection Details

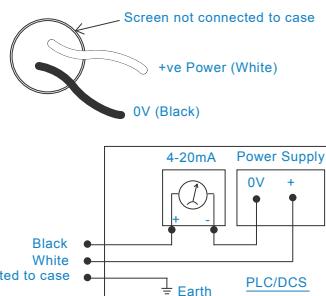


Technical Performance

Technical Performance		Mechanical	
Mounted Base Resonance	10kHz min	Case Material	Stainless Steel
Acceleration Ranges	see: 'How To Order' table ±10%	Sensing Element/Construction	PZT/Compression
	Nominal 80Hz at 22°C	Mounting Torque	8Nm
Frequency Response	10Hz (600cpm) to 5kHz (300kcpm) ± 5% - ISO10816	Weight	150gms (nominal) 1000 metres
Isolation	Base isolated	Maximum Cable Length	5 metres
Range	50g peak	Standard Cable Length	
Transverse Sensitivity	Less than 5%	Screened Cable	Flame Retardant - length to be specified with order
		Mounting Threads	see: 'How To Order' table

Electrical

Current Output	4-20mA DC proportional to acceleration	Operating Temperature Range	see: attached certification details
Supply Voltage	15-30 Volts DC (for 4-20mA)	Sealing	IP65
Settling Time	2 seconds	Maximum Shock	5000g
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts	EMC	EN61326-1:2013
Case Isolation	>10 ⁸ Ohms at 500 Volts		

Typical Frequency Response

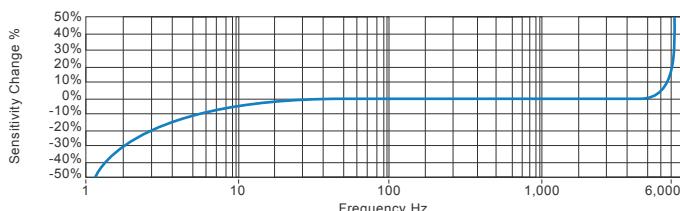


Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP65
Maximum Shock	5000g
EMC	EN61326-1:2013

Applications

Fans, Motors, Pumps, Compressors, Centrifuges, Conveyors, Air Handlers, Gearboxes, Rolls, Dryers, Presses, Cooling, VAC, Spindles, Machine Tooling, Process Equipment

Vibration sensor should be firmly fixed to a flat surface (spot face surface may be needed to be produced and cable anchored to sensor body.)



Certifications



This product is certified in accordance with
UL 913, 8th Ed. Rev. December 6, 2013
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice
TS066.18




HS-422I/M Intrinsically Safe Accelerometer

4-20mA acceleration output via Flame Retardant Cable

Intrinsically Safe Requirements

Maximum Cable Length	nominal 100 metres see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231
Certificate details: Group I + II	IECEx BAS08.0034X Baseefa08ATEX0086X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C Zone 20, AEx, ia, IIIC, T130°C, IP65, Da, -40°C to +110°C	
	Ex ia IIC T6 Ga Ex ia IIIC T80°C IP65 Da Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	Barrier 1 x Pepperl + Fuchs Galvanic Isolator KFD2-STC4-Ex1, which has superseded KFD2-CR-Ex1.30300 (BAS01ATEX7164) see attached system drawings
Certificate details: Group II	Ex ia IIC T4 Ga Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)	Ex ia IIC T4 Ga Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)	1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217) or Pepperl + Fuchs Zener Barrier Z787 (BAS01ATEX7005) or any other barrier that conforms to system drawings attached
Accelerometer System Certificate	Baseefa08Y0087 Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Zener Barrier	see attached system drawings
Terminal Parameters	Ui = 28V, li = 115mA, Pi = 0.65W Group II Ui = 16.5V Pi = 0.65W or Ui = 28V li = 115mA Pi = 0.65W Group I	System Connections for Galvanic Isolator	see attached system drawings
500V Isolation	Units Will Pass A 500V Isolation Test	Terminal Parameters	Ui = Vmax = 28V li = lmax = 115mA Pi = 0.65W
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust) Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)	Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
Australia Approval Group 1	IECEx ITA 10.0003X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)		
South African Approval	Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

How To Order

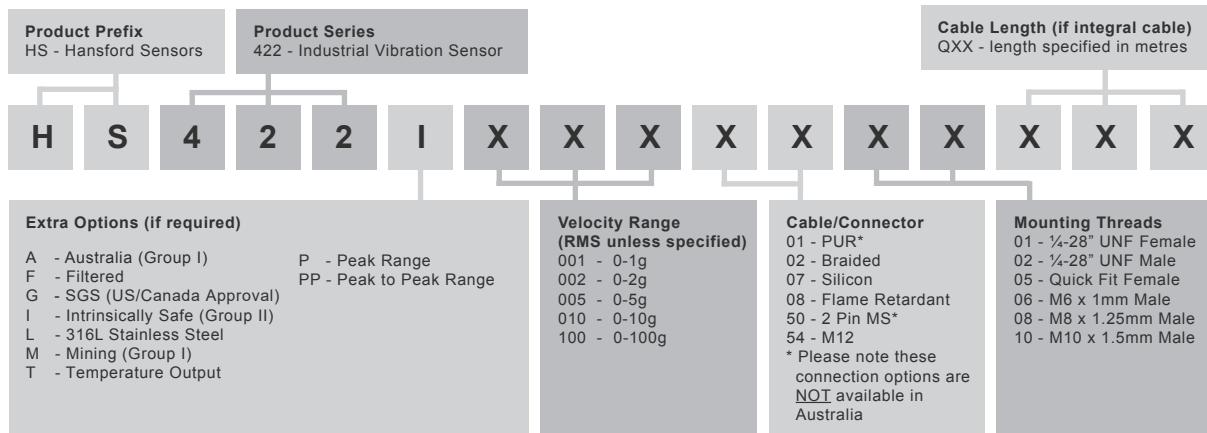

A

B

C

D

E

A

B

C

D

E

Non-hazardous area apparatus which is unspecified except that it must not be supplied from nor contain under normal or abnormal conditions, a source of potential with respect to earth in excess of 250 volts DC. under normal conditions the potential at the connections to the galvanic isolator must not exceed 40 volts DC.

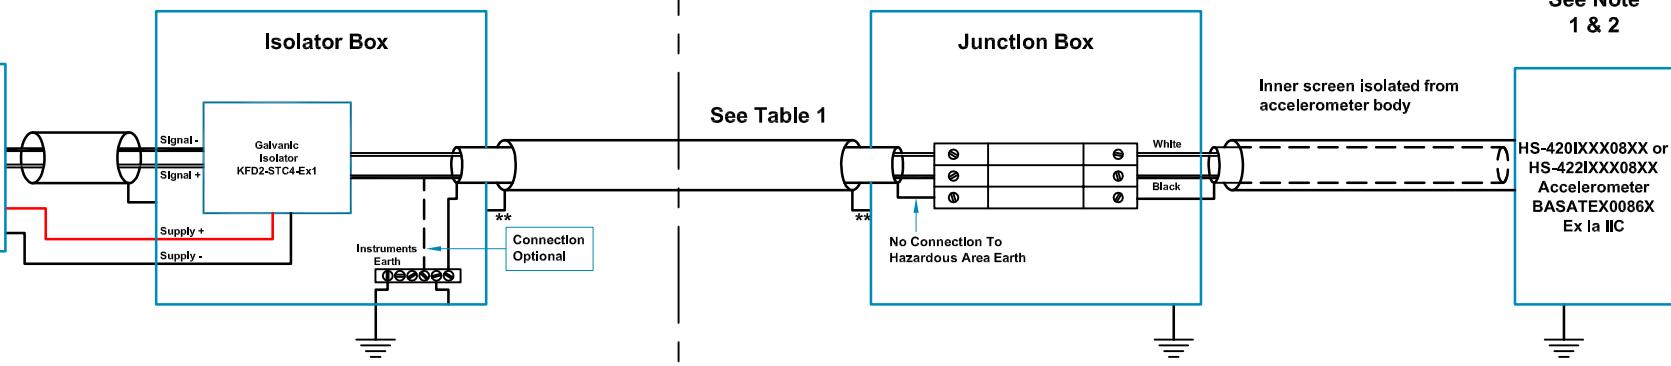


Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length \leq 10m

Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.097	72
IIB	0.768	277
IIA	2.598	585

Accelerometer With Integral Cable Length \leq 50m

Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.091	72
IIB	0.762	277
IIA	2.592	585

Accelerometer With Integral Cable Length \leq 100m

Group	Capacitance μ F	L/R Ratio μ H/ Ω
IIC	0.083	72
IIB	0.754	277
IIA	2.584	585

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System

Ex ia IIC T6 (-40°C \leq Ta \leq +60°C)

Notes:

1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
3. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A
A	Release	17/06/10	MJS	CMH	

Tolerances Unless Stated
0 or 0.0 \pm 0.5
0.00 \pm 0.15 $\frac{1.6}{\vee}$ Finish All Over
Angle \pm 5° Threads g6 H6

Hansford Sensors
Excellence in Vibration Monitoring

Hansford Sensors Ltd
Saunderton Business Park
Haw Lane
Saunderton
Bucks HP14 4JE



Description: System Connections
For HS-420I & HS-422I Group II
Accelerometers With Non Armoured
FR Polyurethane Cable
F.U.W. Galvanic Isolation

Drawing No: M06-033-A

All Dimensions In mm Unless
Otherwise Stated

If In Doubt - Ask!

Scale: NTS
Sheet: 1 of 1

Form Number:
QF024 Issue 1

HS-422I/M Intrinsically Safe Accelerometer

4-20mA acceleration output via M12 Connector

Key Features



- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Customisable features

Industries

Building services, Pulp and Paper, Mining, Metals, Utilities, Automotive, Water, Pharmaceutical



Connection Details

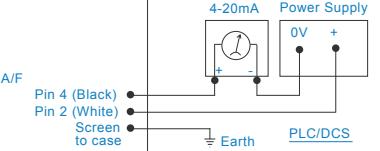

Technical Performance

Mounted Base Resonance	10kHz min
Acceleration Ranges	see: 'How To Order' table $\pm 10\%$ Nominal 80Hz at 22°C
Frequency Response	10Hz (600cpm) to 5kHz (300kcpm) $\pm 5\%$ - ISO10816
Isolation	Base isolated
Range	50g peak
Transverse Sensitivity	Less than 5%

Mechanical

Case Material	Stainless Steel
Sensing Element/Construction	PZT/Compression
Mounting Torque	8Nm
Weight	150gms (nominal)
Screened Cable Assembly	HS-AC010 - straight HS-AC011 - right angle
Mounting Threads	see: 'How To Order' table


Electrical

Current Output	4-20mA DC proportional to acceleration
Supply Voltage	15-30 Volts DC (for 4-20mA)
Settling Time	2 seconds
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts
Case Isolation	$>10^8$ Ohms at 500 Volts

Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP67
Maximum Shock	5000g
EMC	EN61326-1:2013


Typical Frequency Response

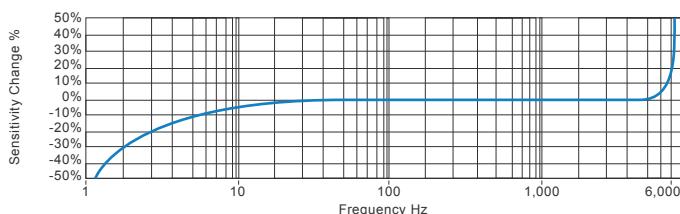

Applications

Fans, Motors, Pumps, Compressors, Centrifuges, Conveyors, Air Handlers, Gearboxes, Rolls, Dryers, Presses, Cooling, VAC, Spindles, Machine Tooling, Process Equipment

Vibration sensor should be firmly fixed to a flat surface (spot face surface may be needed to be produced and cable anchored to sensor body.)



Certifications



This product is certified in accordance with
UL 913, 8th Ed. Rev. December 6, 2013
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice

TS067.19




HS-422I/M Intrinsically Safe Accelerometer

4-20mA acceleration output via M12 Connector

Intrinsically Safe Requirements


Maximum Cable Length	See website: www.hansfordsensors.com see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231
Certificate details: Group I + II	IECEx BAS08.0034X Baseefa08ATEX0086X	Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C Zone 20, AEx, ia, IIIC, T130°C, IP65, Da, -40°C to +110°C	
	Ex ia IIC T6 Ga Ex ia IIIC T80°C IP65 Da Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	② II 1GD ② I M1 ② I Ma	Barrier 1 x Pepperl + Fuchs Galvanic Isolator KFD2-STC4-Ex1, which has superseded KFD2-CR-Ex1.30300 (BAS00ATEX7164) see attached system drawings
Certificate details: Group II	Ex ia IIC T4 Ga Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)	② II 1GD	1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217) or Pepperl + Fuchs Zener Barrier Z787 (BAS01ATEX7005) or any other barrier that conforms to system drawings attached
Accelerometer System Certificate	Baseefa08Y0087 Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Zener Barrier	see attached system drawings
Terminal Parameters	Ui = 28V, Ii = 115mA, Pi = 0.65W Group II Ui = 16.5V Pi = 0.65W or Ui = 28V Ii = 115mA Pi = 0.65W Group I	System Connections for Galvanic Isolator	see attached system drawings
500V Isolation	Units Will Pass A 500V Isolation Test	Terminal Parameters	Ui = Vmax = 28V Ii = Imax = 115mA Pi = 0.65W
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust) Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)	Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
Australia Approval Group 1	IECEx ITA 10.0003X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)		
South African Approval	Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

How To Order

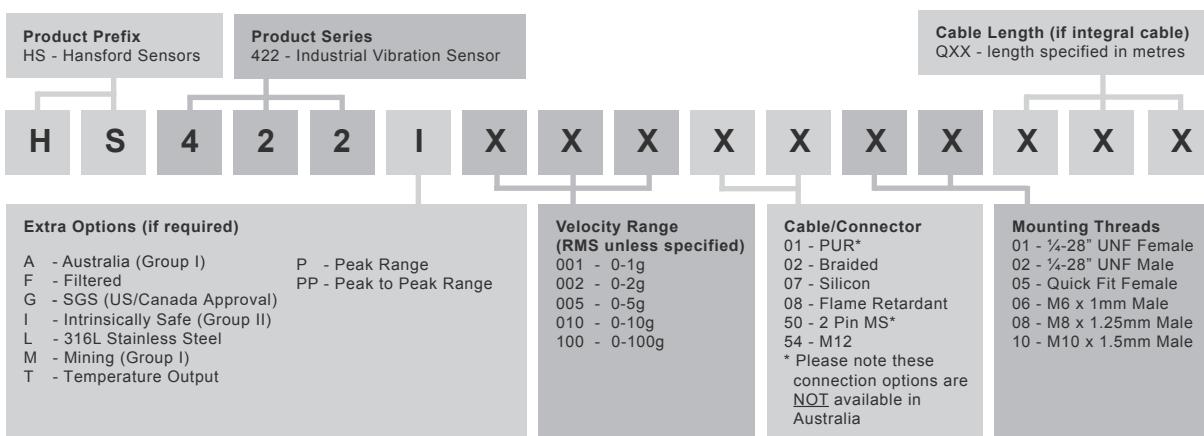


Non-hazardous area apparatus which is unspecified except that it must not be supplied from nor contain under normal or abnormal conditions, a source of potential with respect to earth in excess of 250 volts DC. under normal conditions the potential at the connections to the galvanic isolator must not exceed 40 volts DC.

Non-Hazardous Area

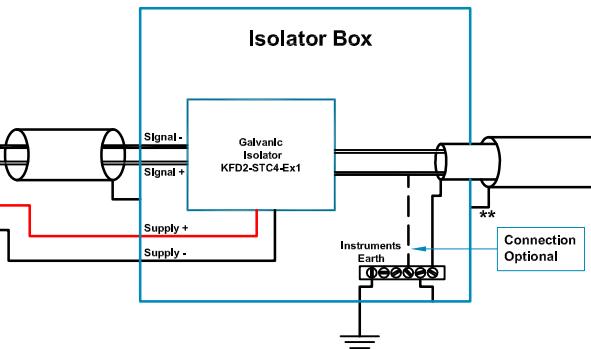

Hazardous Area

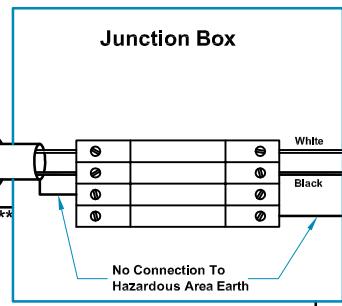

Screen connected
accelerometer body
via connector body

See Note
1 & 2

HS-420XXX54XX or
HS-422XXX54XX
Accelerometer
BASATEX0086X
Ex ia IIC

25 Metres Max

**Outer shield only
connected to chassis via
Ex approved cable gland

Table 1: Cable Connecting The Connector Version

Group	Capacitance μF	L/R Ratio $\mu\text{H}/\Omega$
IIC	0.096	72
IIB	0.767	277
IIA	2.597	585

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System

Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

Notes:

1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
3. The Installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.


Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A
A	Release	31/03/08	MJS	CMH	

Tolerances Unless Stated
0 or 0.0 ± 0.5
0.00 ± 0.15
Angle $\pm 5^\circ$

$\frac{1.6}{\checkmark}$ Finish All Over
Threads g6 H6



Hansford Sensors Ltd
Saunderton Business Park
Haw Lane
Saunderton
Bucks HP14 4JE



Do Not Scale

All Dimensions in mm Unless
Otherwise Stated

If In Doubt - Ask!


Description: System Connections
For HS-420I & HS-422I Group II
Accelerometers With Connectors
F.U.W. Galvanic Isolation

Drawing No: M06-034-A

Scale: NTS

Form Number:

Sheet: 1 of 1

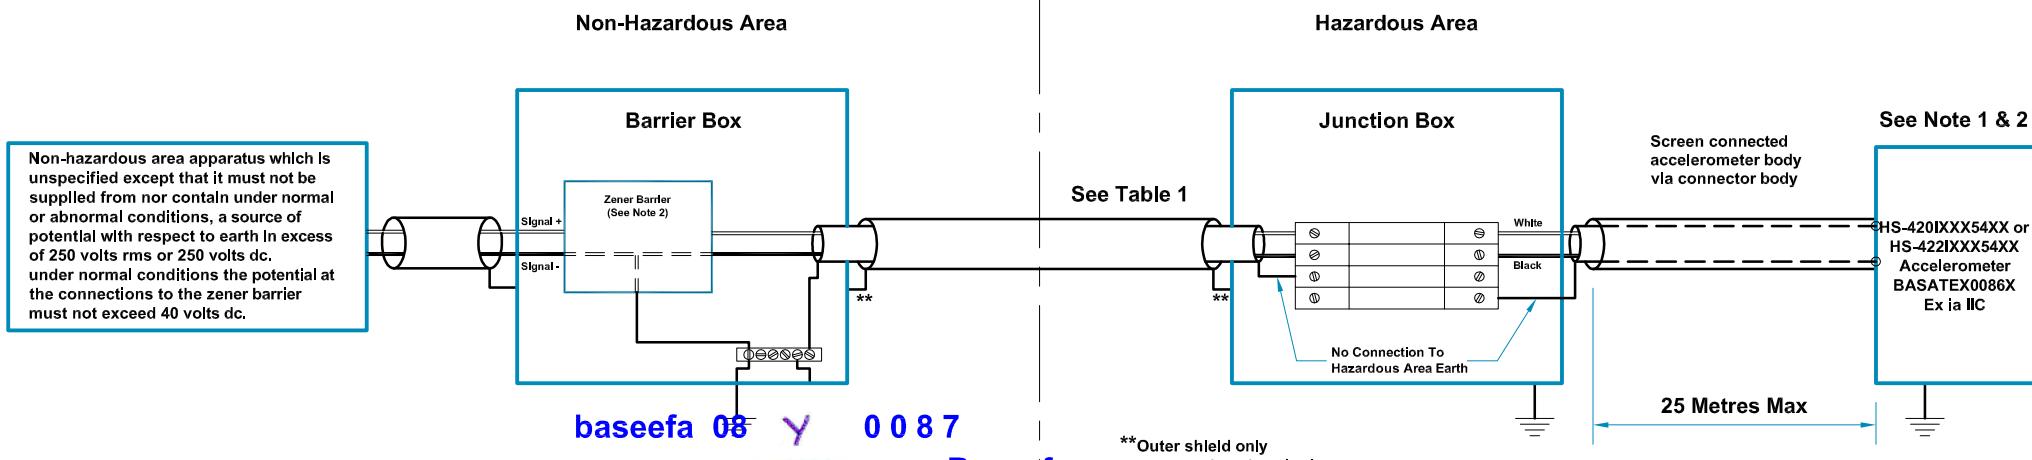

Baseefa

Baseefa Certification Schedule Drawing

**Outer shield only
connected to chassis via
Ex approved cable gland

Table 1: Cable Connecting The Connector Version

Group	Capacitance μF	L/R Ratio $\mu\text{H}/\Omega$
IIC	0.080	56
IIB	0.246	168
IIA	0.661	448

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System
Baseefa08Y0087
ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

Notes:

1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere
3. Any shunt zener diode safety barrier certified by an EC approved body to [IEEx ia] IIC having the following output parameters: $U_o = 28V$ dc, $I_o = 93mA$ dc, $P_o = 0.65W$. e.g. MTL7787+ to BAS01ATEX7217 or Pepperl + Fuchs Z787 to BAS01ATEX7005
4. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.